

APD 1915 M

Mitsubishi

D+ &



ISO8528

GC ,) &

SZUTEST

GC - \$\$\$%



2000/14/EC

&\$\$\$#(#

z) \$ z' z' D:

	"	kw	"	kw	Amp
400/230	1915,00	1532,00	1750,00	1400,00	2529,00

fP GDE

GC ,) &

,) & z

fDF DE

%\$1

% %&


GC " \$(**

z&(

GC

Standard Specifications

- Water cooled diesel engine
- Radiator with mechanical fan
- Protective grille for rotating and hot parts
- Electric starter and charge alternator
- Starting battery (with lead acid) including rack and cables
- Engine coolant heater
- Steel base frame and anti-vibration isolators
- Spare external fuel tank (open set)
- Flexible fuel connection hoses
- Single bearing, class H alternator
- Industrial exhaust silencer and steel bellows supplied separately
- Static battery charger
- Manual for application and installation
- Generators Sets' voltage and frequency regulation comply with ISO 8528-5
- Generators Sets' can take 100% load at one step according to NFPA110

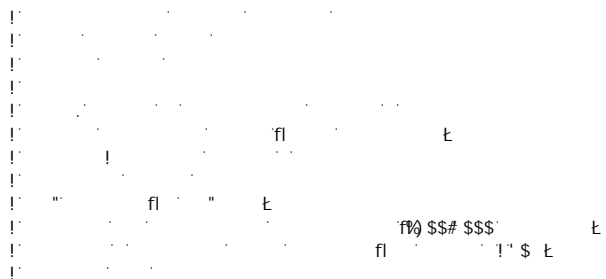

TRANSFER SWITCH

APD 1915 M

Mitsubishi

D+' &'




Manufacturer		Mitsubishi
Model		S16R-PTA
		1620,00 kw [2172,00HP]
	L	65,370
	"	170 X 180
		14:1
	"# "	1500
	L	230,00
	L	350,00
AbsorbedAirDischargeReSourceKey.Text	' # "	128,00
	' # "	1950,00
	' # "	339,00
		24 V d.c.
	Load	%\$ \$i
	# "	
		355,00

		ECO46-2S/4
	Hz	50
	"	1800,00
7cg		0,80
		3
	fl Ł	400/230

		fl Ł		fl Ł	
	"	"	"	"	L
APD 1915 M	13850,00	5200,00	2300,00	2600,00	2000,00
		fl Ł		fl Ł	
	"	"	"	"	L
AK 99	18950	9000	2800	3478/4452	2200

D+' &'

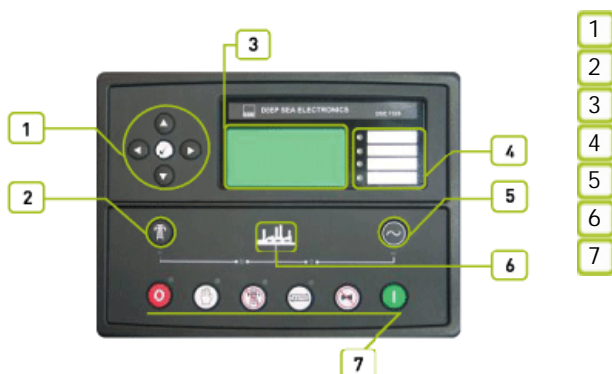

APD 1915 M

Mitsubishi

D+' &'



1

'8G9ž + ' &\$ž

) 5ž&&\$#&(\$

2

3

4

'8G9+' &\$
&&\$ ž

fl

"'8G9+' &\$

'8G9+' &\$

ž

% &I '* (

žFG&' &žFG(,) ž

ž

APD 1915 M

Mitsubishi

D+ &



f@z@Bl
f@z@Bl

" " " "
" " " "

f@z@Bl

971

#

#

#

#

#

6G 9B *\$-\$) \$

6G 9B *%\$\$\$!*!&

6G 9B *%\$\$\$!*!(

f&) (, t

f&%) +t

f&%) \$t

GA 8

"

)

ž

ž

! & + " " "

"

% , ! & * (

& (\$)

ž

ž

ž

"

"

"


"

"

APD 1915 M

Mitsubishi

D+ & "

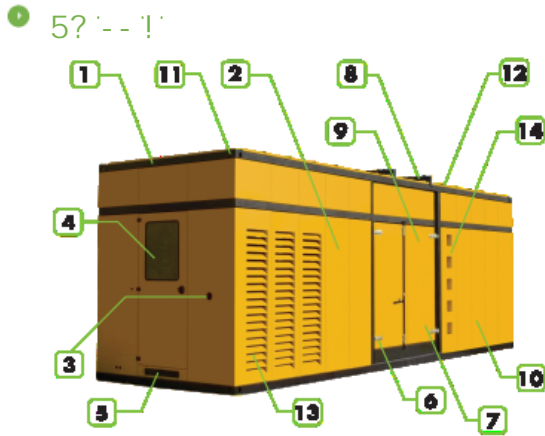

- 1 Steel structure made from steel sheet and steel profiles.
- 2 canopy and panels made from powder coated sheet steel.
- 3 Emergency stop push button.
- 4 Control panel is mounted on the baseframe . Located at the back of the generator set
- 5
- 6 Cables out locations are back of the canopy.
- 7 Corrosion-resistant locks and hinges.
- 8 oil could be drained via valve and a hose
- 9 Exhaust system on the canopy.
- 10 special large access doors for easy maintenance
- 11 the cap on the canopy provides easy access to radiator cap.
- 12 Lifting points similar to ISO container , located on each top corner of the canopy.
- 13
- 14 sound proofing materials

	"	2800
fl "L	"	9000
fl "L	"	3478/4452
	L	2200